


REMOTE READER HEIGHT = 3' MIN - 5' MAX

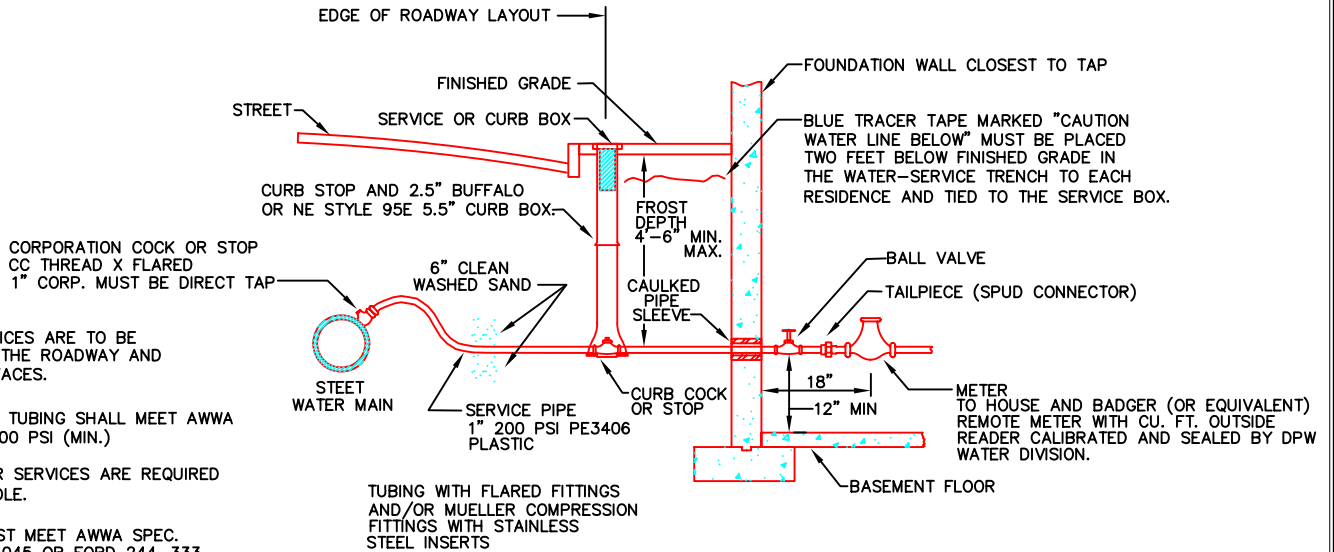

NOTE:
ALL WATER SERVICES ARE TO BE
SLEEVED UNDER THE ROADWAY AND
ALL PAVED SURFACES.

PLASTIC 200 PSI TUBING SHALL MEET AWWA
SPEC. AND BE 200 PSI (MIN.)

1.5" AND LARGER SERVICES ARE REQUIRED
TO HAVE A SADDLE.

CURB STOPS MUST MEET AWWA SPEC.
800-55 (HAYS 5045 OR FORD 244-333
AND 244-444) W/ NO DRAIN.

CORPORATION STOP SHALL MEET AWWA
SPECS. (MUELLER B-25008 OR FORD
F-1000 G)

TYPICAL WATER SERVICE CONNECTION
NOT TO SCALE



TOWN OF NATICK, MASSACHUSETTS

DEPARTMENT OF PUBLIC WORKS - ENGINEERING DIVISION

75 WEST STREET NATICK, MA 01760

DETAIL SHEET - WATER

Detail Name:
WATER SERVICE CONNECTION

Date Last Updated:
october 17, 2005